


METROPOLITAN UTILITIES DISTRICT

CONSTRUCTION STANDARD FOR: Pipe Embedment for 16" and Smaller Water Mains

No. 1.11.2
Page: 1 of 1
Effective: 2-1-06
Prepared by: WRT
Approved by: JGL

GENERAL

Pipe embedment shall be per the drawing below. Bedding shall provide uniform and continuous support of the pipe between bell holes. After assembly of the pipe, embedment material shall be placed and compacted uniformly and simultaneously along each side of the pipe to prevent pipe displacement and provide haunch support.

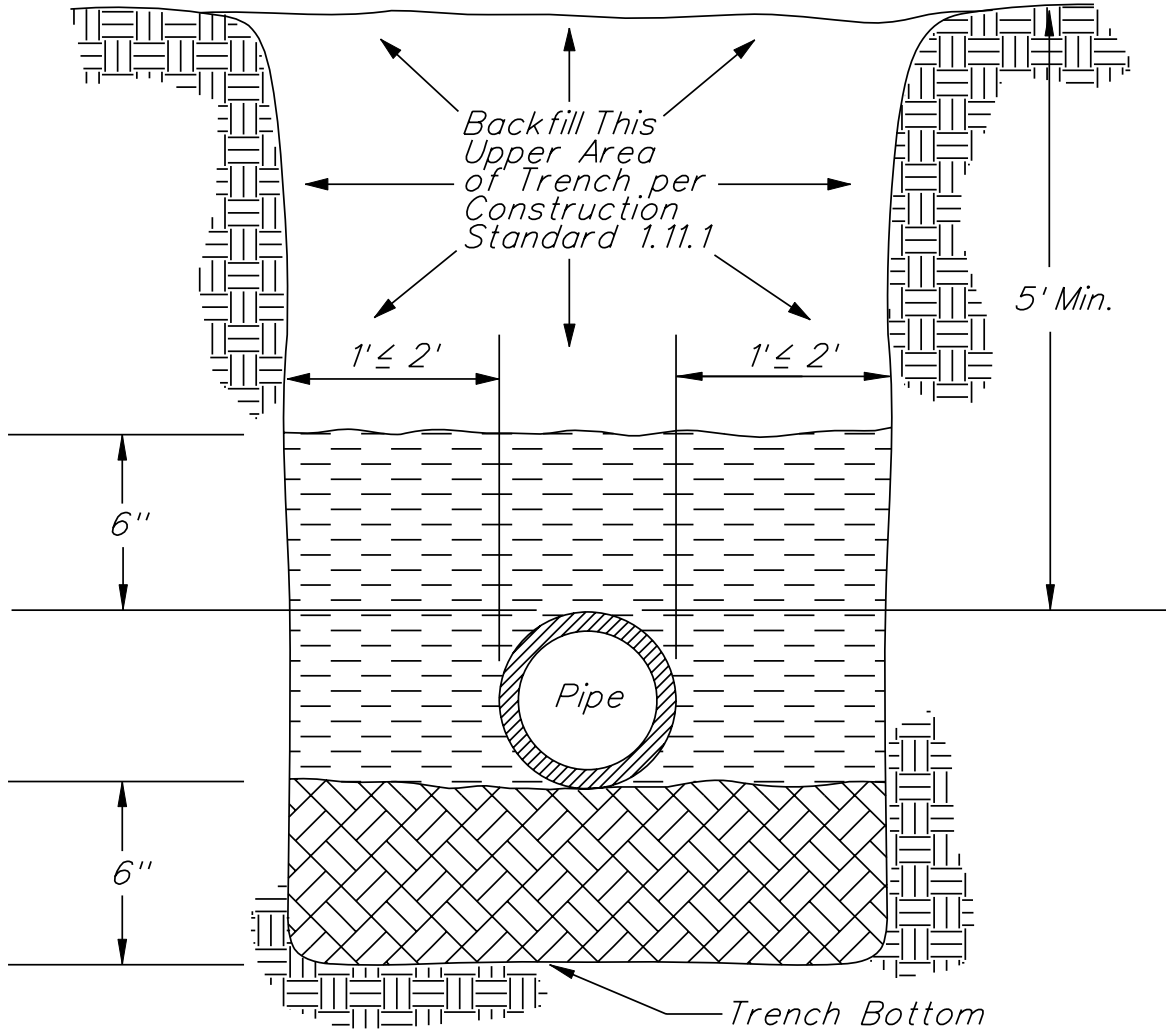

Pipe bedding shall be of suitable native soil lightly compacted to provide for a firm, stable and uniform support of the pipe.



Pipe embedment shall be of suitable native soil compacted to provide firm and stable haunch support of the pipe.

THIS PAGE IS INTENTIONALLY LEFT BLANK